
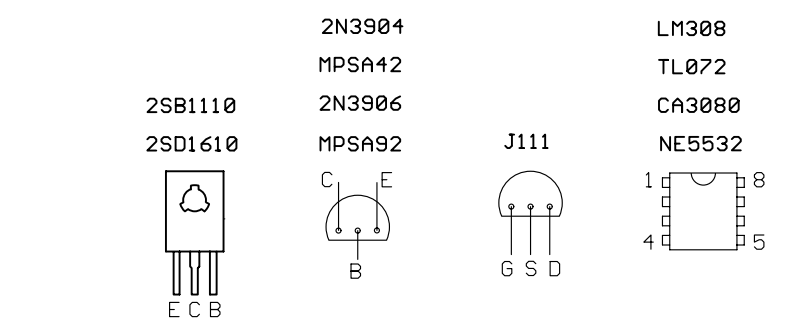


FRONTEND A\_HIGH

FRONTEND B\_HIGH

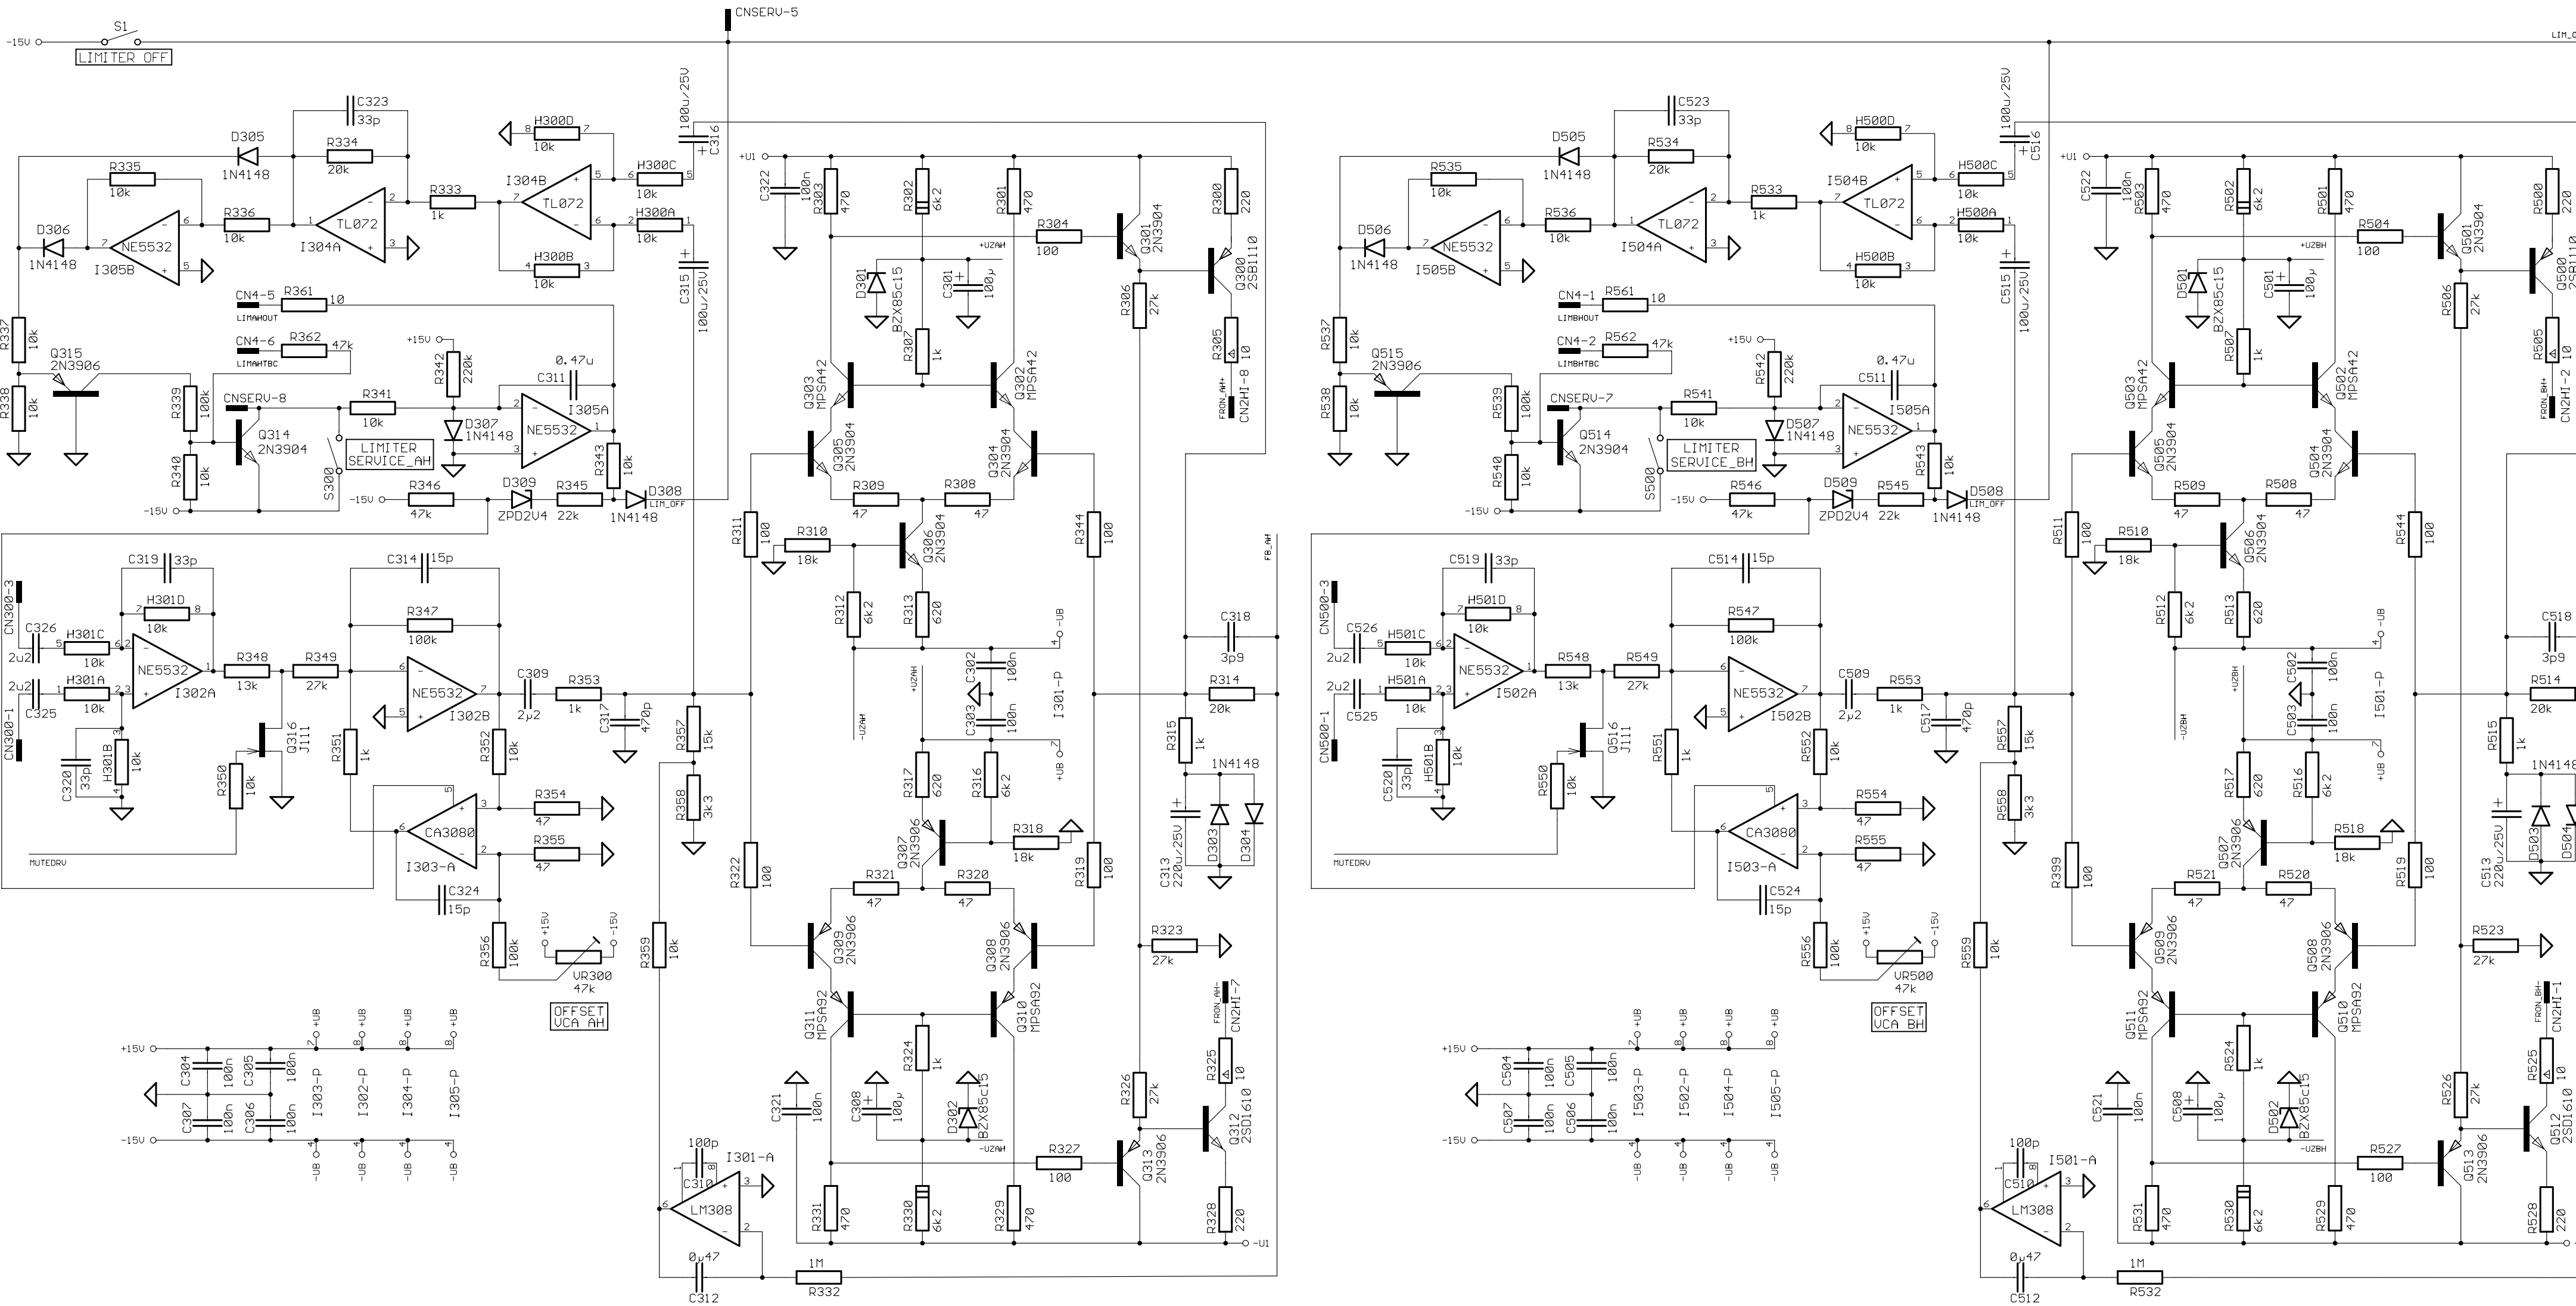

SAFETY COMPONENT  
(MUST BE REPLACED BY ORIGINAL PART)

AC VOLTAGE 1000 HZ, MEASURED WITH UTVM

DC VOLTAGE MEASURED WITH VOLTMETER 100kOHM/V

CNSERV	
1	-15V
2	+15V
3	Fan-Voltage
4	GND
5	Lim_Off
6	GND
7	Lim_Serv_BH
8	Lim_Serv_AH
9	Lim_Serv_BL
10	Lim_Serv_AL
11	+U1
12	-U1
13	+U2
14	-U2

CN2HI	
1	Input- BH
2	Input+ BH
3	NTC BH
4	+15V
5	NTC AH
6	SOA-Sense
7	Input- AH
8	Input+ AH

CN4	
1	LIMBHOUT
2	LIMBHTBC
3	n.c.
4	n.c.
5	LIMAHOUT
6	LIMAHBTC

ALTERATIONS RESERVED!

				Last modified: 20.05.1999 10:57:02		86227C MAIN_PCB	
				Last plotted: 26.10.2000 14:34:01			
				1996	DATE	NAME	CIRCUIT DIAGRAM
				DSG'D	21.2.	M. Brandl	
				CHK'D	21.2.	M. Brandl	3/4
				APP'D			
				D	58/99	05.99	SP3/5/7 / XA2600 / PM2600
				C	13/97	05.03.	
				B	60/96	08.05.	351759
				A	Nullserie	16.04.	
				SYMB.	REVISION	DATE	NAME

DYNACORD